



Notes:

1. Use the $\frac{3}{4}$ " NPT "Isolation Coupling" supplied and *hand tighten* only. Do not clamp sensor body or stem.
2. Locate the sensor 1 ft (30 cm) from the sidewall or obstruction for every 10 ft (3 m) depth.
3. Do not mount in direct sunlight.
4. Extend sensor cable up to 500 ft (150 m) with RG62AU coaxial only.


FLANGE MOUNT

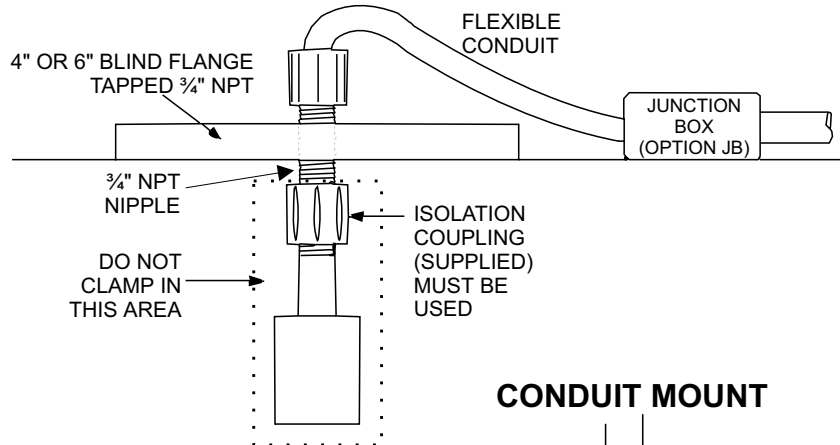


CROSS BAR MOUNT

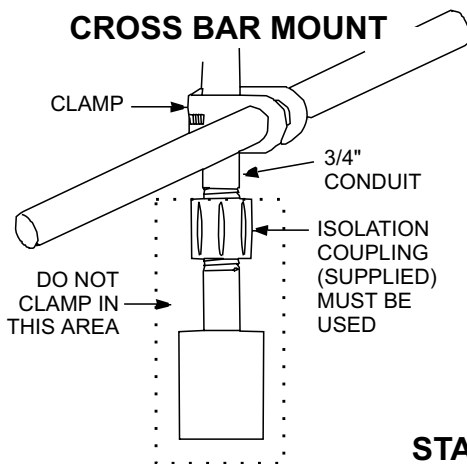

STAND PIPE MOUNT

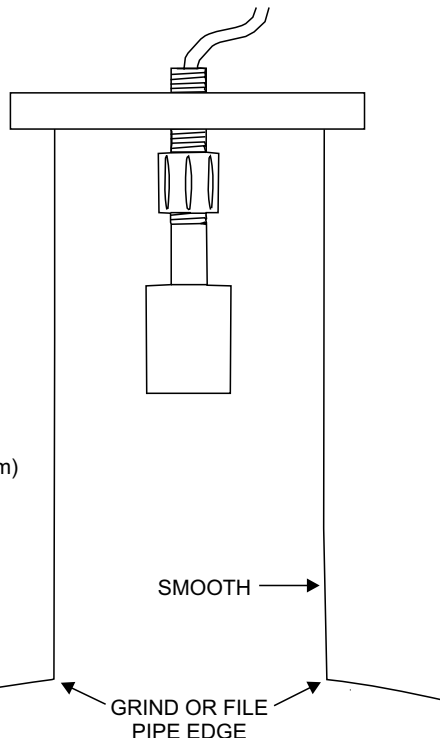

CONDUIT MOUNT

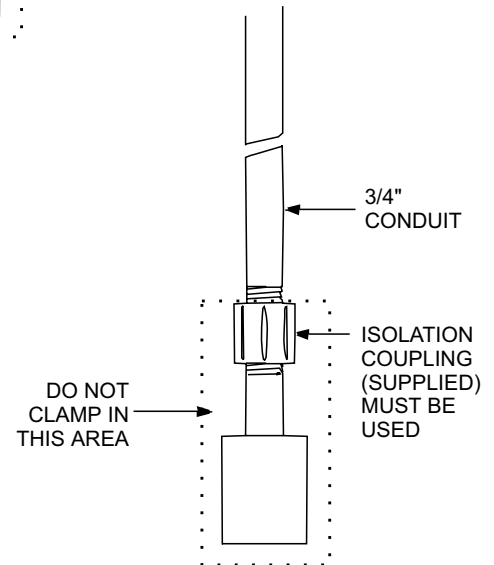

ANGLE MOUNT

